


6.3. Hydraulic diagram



The eMAX Heat Exchanger is integrated into the boiler returnflow.

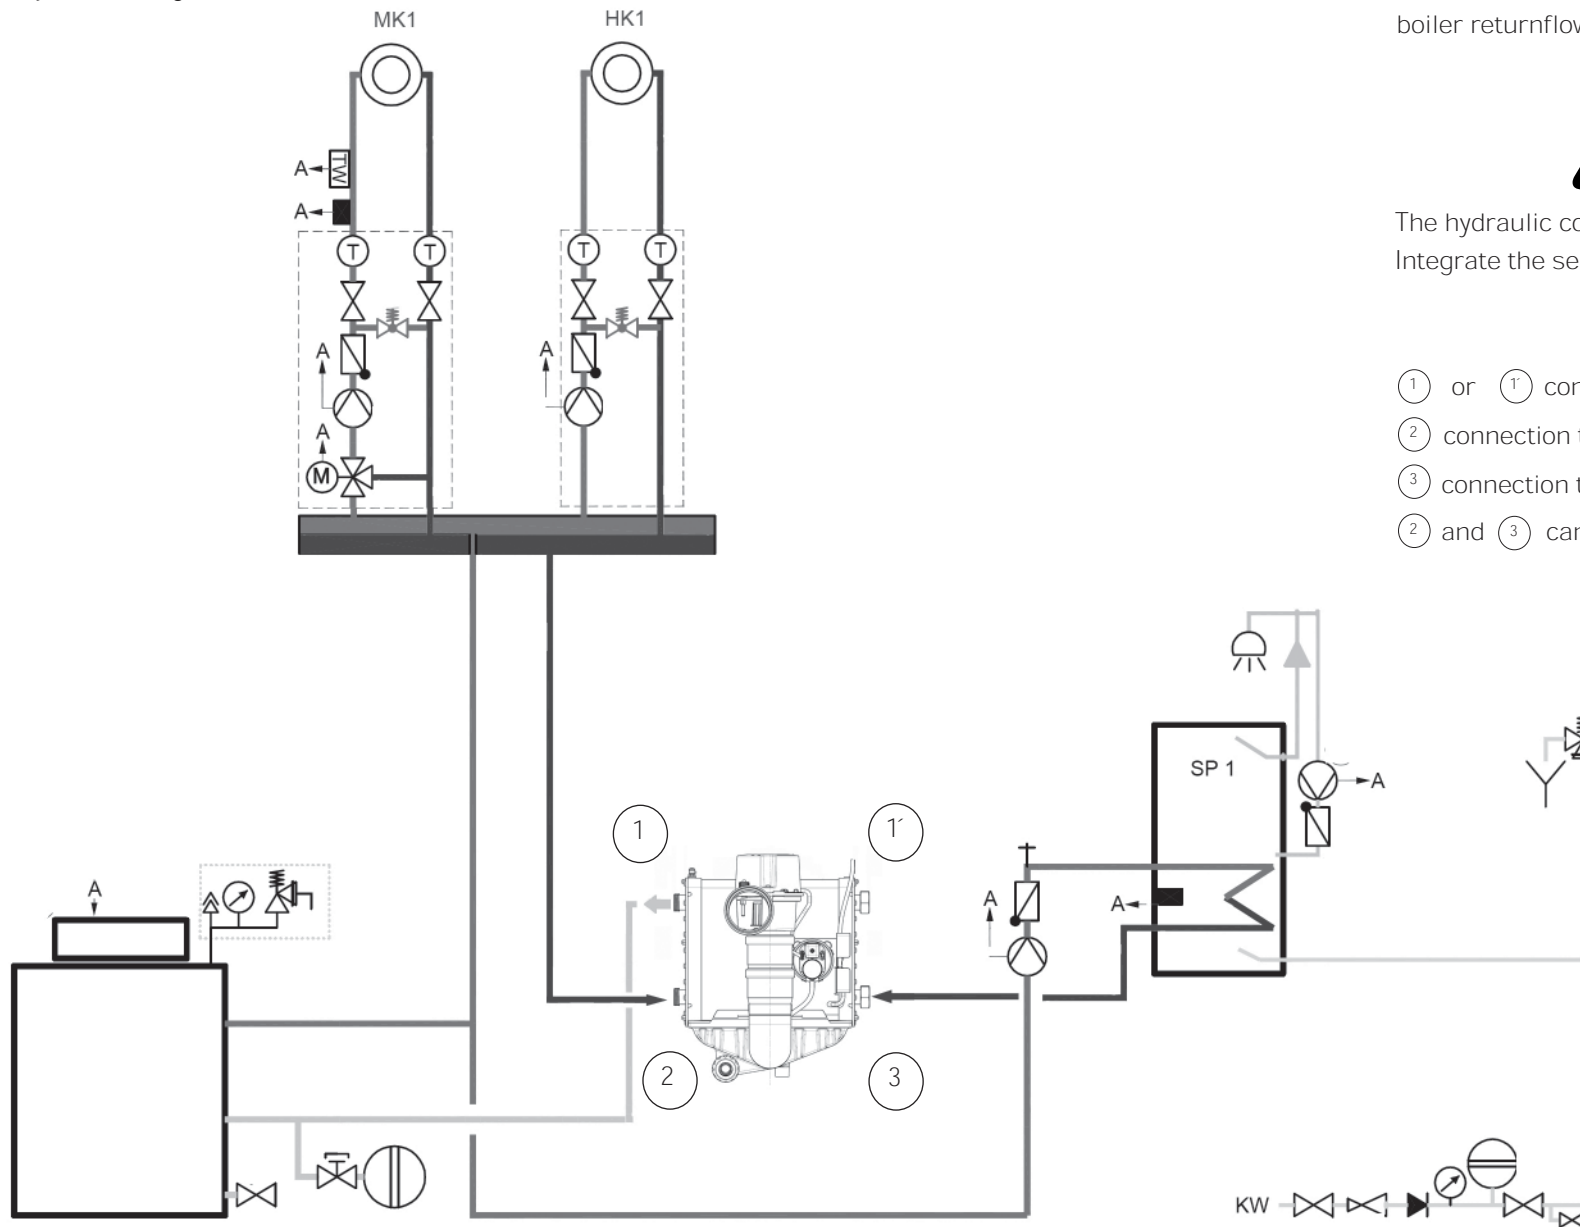

The hydraulic connections must not be closed!
Integrate the service water return flow!

- ① or ①' connection to boiler return flow
- ② connection to heat circuit return flow
- ③ connection to return of storage tank
- ② and ③ can be changed